

1

2

3





4

powerPL/PLX275 400Hp
 Drive Calibration: 650A
 I dc : 650A
 I ac : 540A

powerPL/PLX315 450Hp
 Drive Calibration: 750A
 I dc : 750A
 I ac : 612A

powerPL/PLX360 500Hp
 Drive Calibration: 850A
 I dc : 820A
 I ac : 681A

powerPL/PLX400 550Hp
 Drive Calibration: 950A
 I dc : 950A
 I ac : 775A

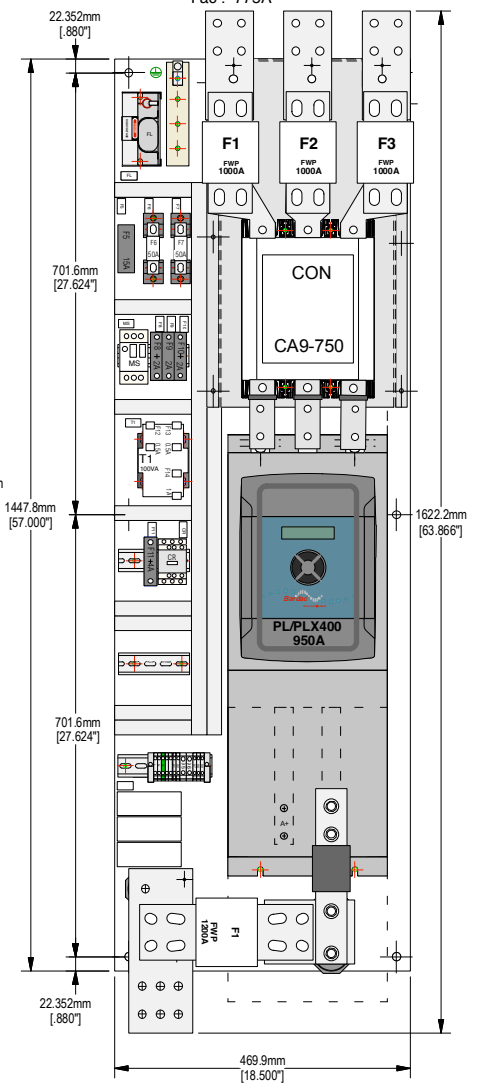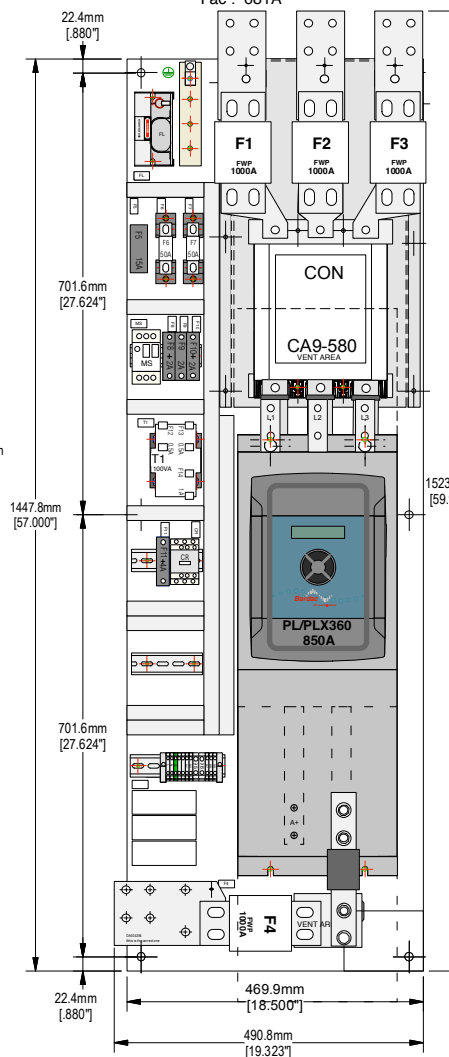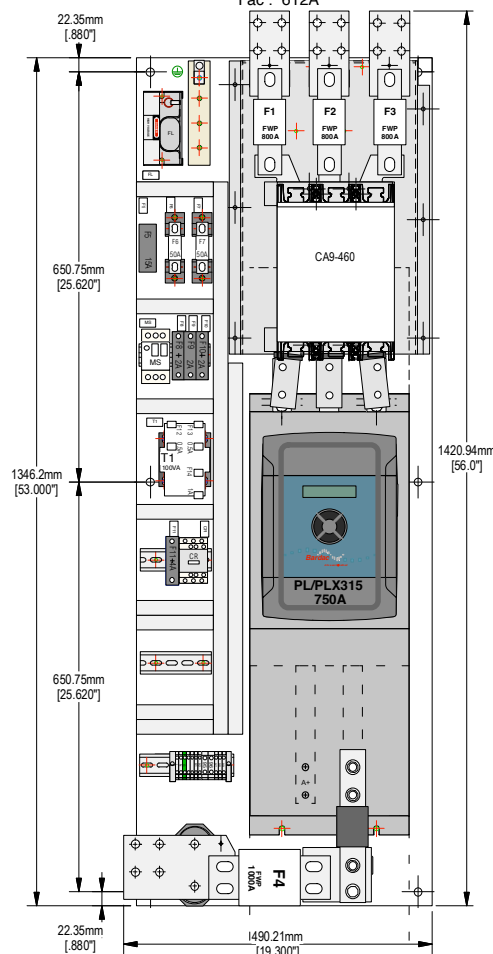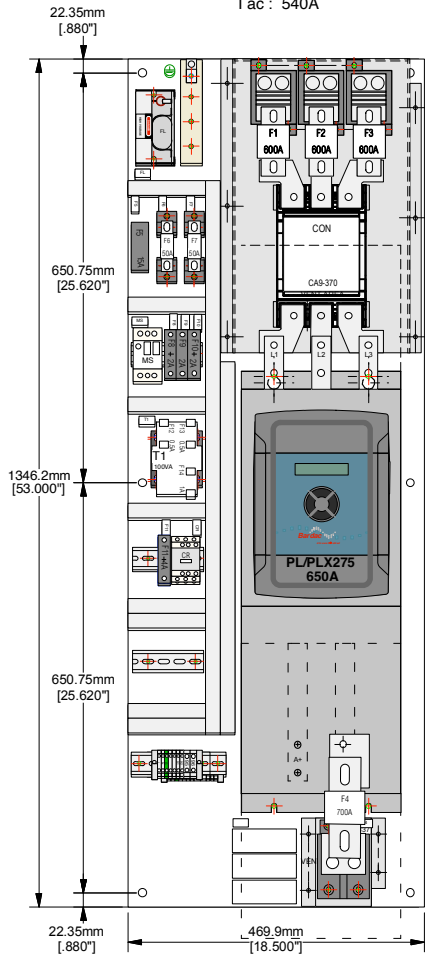

ISS	DATE	APPROVED
A	22 APR 22	R. WILLIAMS
B	19 JAN 24	R. WILLIAMS

NOTE: MS AND TERMINALS 97,98,99 FITTED WITH BLOWER OPTION.
 TERMINAL ORDER WITH OPTION: L,N,G,91,92,95,96,97,98,99
 TRANSFORMER T1 AND FUSES F12,F13,F14 ARE AN OPTIONAL FAN SUPPLY

NOTE: POWER DRIVES PL275,315,360 HAVE NO DC FUSE FITTED.

Bardac
 40 Log Canoe Circle, Stevensville, MD 21666
 phone (410) 604-3400 fax: (410) 604-3500
 email: info@bardac.com

SHT. TITLE	MATERIAL	DRAWN	DWG. NO.
PANEL LAYOUT		R. WILLIAMS 22 APR 22	HJ504320
DWG. TYPE	FINISH	CHECKED	DWG. ISS.
POWER DRIVE PANEL TECHNICAL ILLUSTRATION		R. WILLIAMS 22 APR 22	AIB
TITLE	DWG VIEW	APPROVED	SCALE
PL/PLX275-400 POWER DRIVE PANEL ASSEMBLY v2		R. WILLIAMS 22 APR 22	DO NOT SCALE
TOLERANCE		SIZE	SHT. 1 OF 1
		A	